


# CIBSE TM59: corrigenda

Page 7 Table 2: Studio: Occupancy should read: '2 people at 70% gains from 11 pm to 8 am; 2 people at 100% gains from 8 am to 11 pm'.


Page 7 Table 2: 3-bedroom apartment; living room: Occupancy should read: '3 people at 75% gains from 9 am to 10 pm; room is ..... of the day'.

Page 8 Figure 1: Values for studio occupancy amended; corrected version attached.

Page 8 Figure 2 amended: corrected version below.

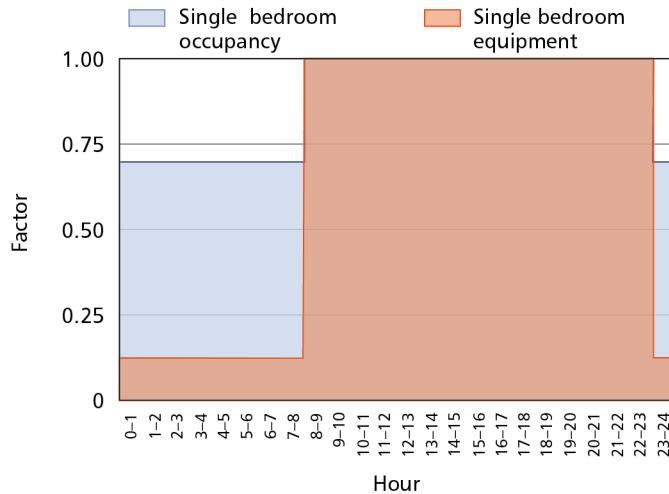

Page 9 Figure 7 amended: corrected version below

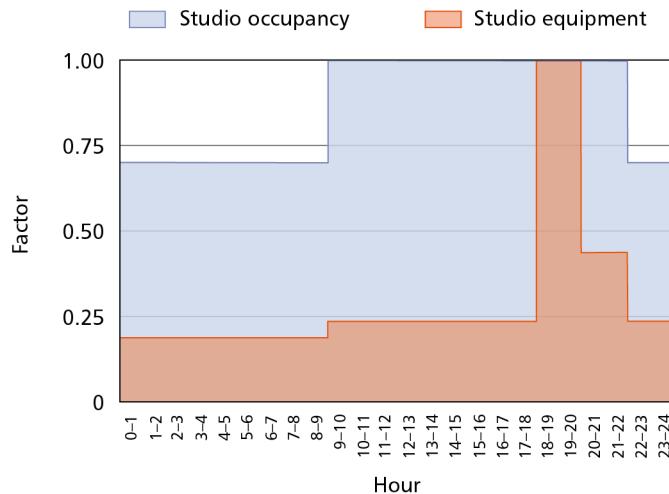

Number of people	Description	Peak load (W)		Period																							
		Sensible	Latent	Hour ending																							
		00-01	01-02	02-03	03-04	04-05	05-06	06-07	07-08	08-09	09-10	10-11	11-12	12-13	13-14	14-15	15-16	16-17	17-18	18-19	19-20	20-21	21-22	22-23	23-24		
1	Single bedroom occupancy	75	55	0.7	0.7	0.7	0.7	0.7	0.7	0.7	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0.7	
2	Double bedroom occupancy	150	110	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	1	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.7	
2	Studio occupancy	150	110	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0.7	
1	1-bedroom living/kitchen occupancy	75	55	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	1	1	1	0	0
1	1-bedroom living occupancy	75	55	0	0	0	0	0	0	0	0	0	0	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0
1	1-bedroom kitchen occupancy	75	55	0	0	0	0	0	0	0	0	0	0	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0
2	2-bedroom living/kitchen occupancy	150	110	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	1	1	1	0
2	2-bedroom living occupancy	150	110	0	0	0	0	0	0	0	0	0	0	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0
2	2-bedroom kitchen occupancy	150	110	0	0	0	0	0	0	0	0	0	0	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0
3	3-bedroom living/kitchen occupancy	225	165	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	1	1	1	1	1	1	1	0	
3	3-bedroom living occupancy	225	165	0	0	0	0	0	0	0	0	0	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0	
3	3-bedroom kitchen occupancy	225	165	0	0	0	0	0	0	0	0	0	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0	
	Single bedroom equipment	80	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0.13	
	Double bedroom equipment	80	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	1	1	1	1	1	1	1	1	1	1	1	1	1	1	0.13	
	Studio equipment	450	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	
	Living/kitchen equipment	450	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	0.24	
	Living equipment	150	0.23	0.23	0.23	0.23	0.23	0.23	0.23	0.23	0.23	0.23	0.23	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	
	Kitchen equipment	300	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17		
	Lighting profile	2 (W/m <sup>2</sup> )	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	