


Corrigendum — CIBSE AM17

Page 43, Figure 32

In left-hand grey box ('Air source heat pump'), CoP_s should read CoP_a (two occasions)

Text under right-hand grey box ('Water source heat pump'), Q_a should read Q_t

The corrected figure appears below.

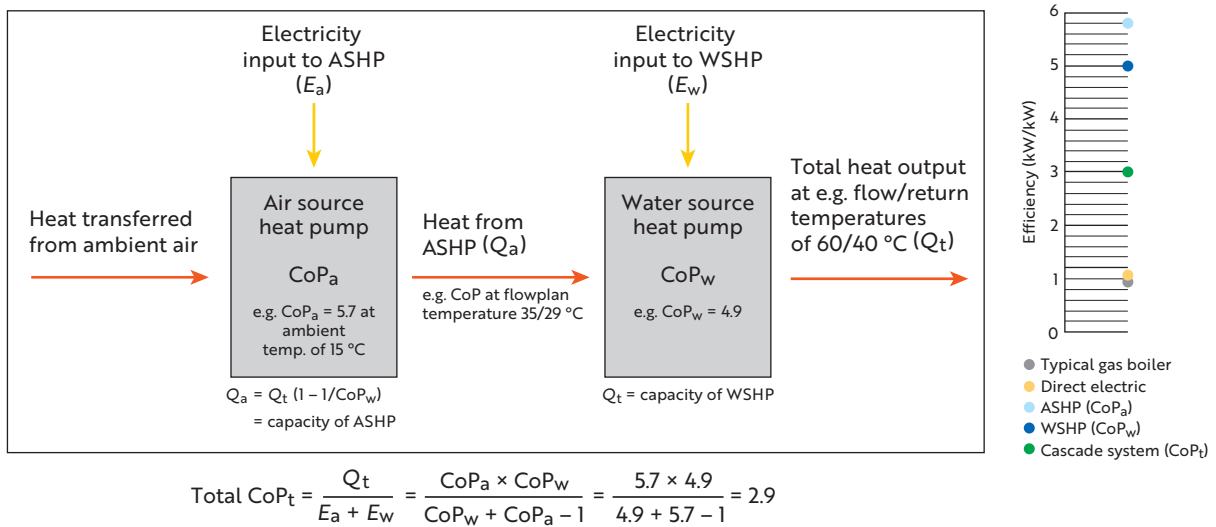

Corrigendum issued 19.07.23