


Corrigenda — CIBSE AM17

Page 43, Figure 32

In left-hand grey box ('Air source heat pump'), CoP_s should read CoP_a (two occasions)

Text under right-hand grey box ('Water source heat pump'), Q_a should read Q_t

The corrected figure appears below.

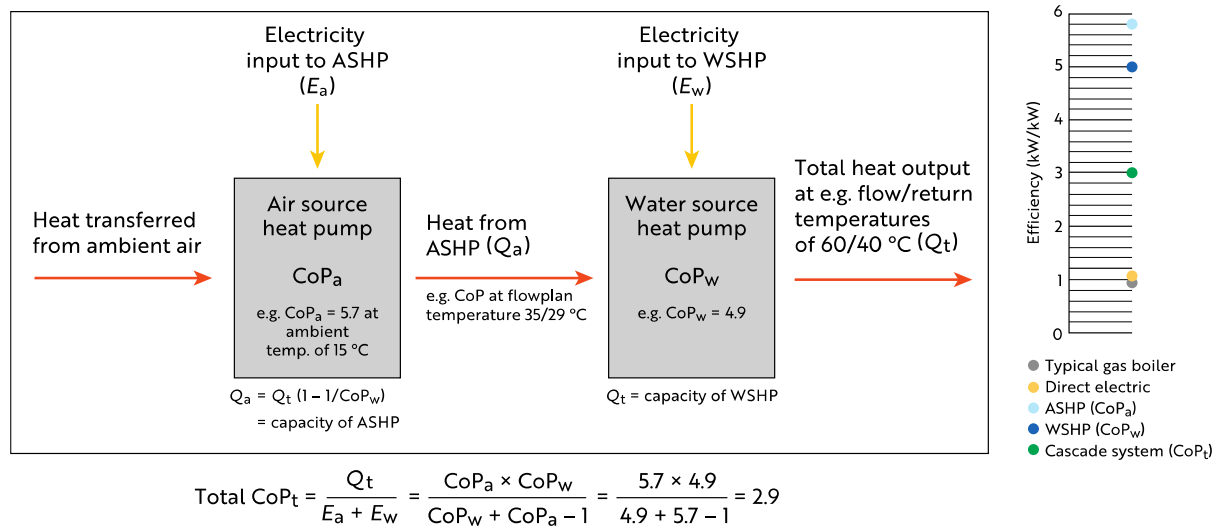

Page 40, Figure 30

The last item in the bullet list headed 'Ambient/energy loop' should read:

- Partially centralised maintenance/ownership and billing

The last item in the bullet list headed 'More decentralised' should read:

- Maintenance/ ownership/ billing decentralised to building level

Corrigendum issued 28.05.24